

GST-M200 Intelligent Fire Alarm Control Panel



Description



GST-M200 Intelligent Fire Alarm Control Panel (FACP) complies to UL864 standard with features of easy installation, operation and maintenance. All circuit boards are installed in a metal cabinet, providing a complete fire control system for most applications.

Features and Benefits


- Single ring loop which meets Style 6 (Class A) requirement
- 240 addressable devices
- Optional 2 loops with additional loop card
- LCD display unit of 128 X 64
- History file with 1,000 events capacity
- "Walk Test", silent or audible
- PAS (positive Alarm Sequence) per point (NFPA72 compliant)
- Auto silent timer option per NAC. The time duration is 5minutes.
- Password and key-protected nonvolatile memory
- Fully programmable from local keypad and from a pc
- Signaling Line Circuit (SLC) operates up to 4000 ft through twisted pair with cross section 17AWG (1.02mm²)

Installation Data

The FACP can be flush-mounted or wall-mounted. Its appearance and the mounting method are shown here.

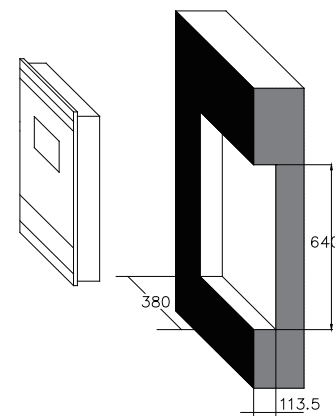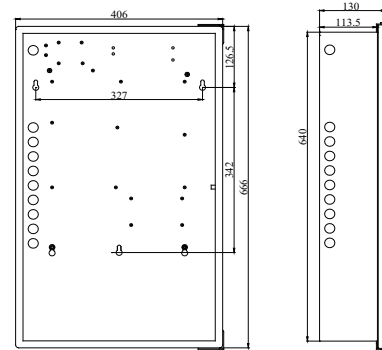

Terminals

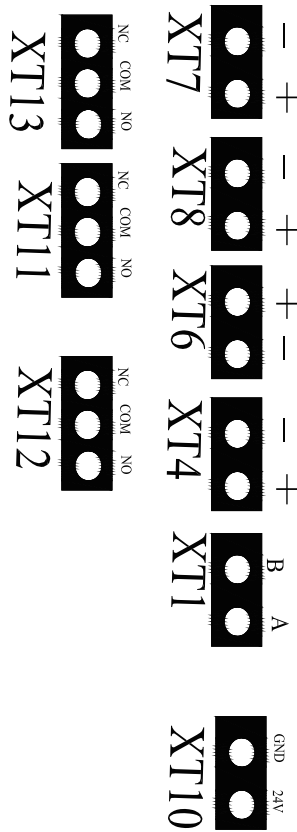

SLC (Signaling Line Circuit) LOOP (XT4 & XT6):
Style 6 (Class A) loop connection, provides communication to addressable detectors.

NAC (Notification Appliance Circuit) XT8 (NAC1) & XT7 (NAC2):

Style Y (Class B) output port, outputs when there is fire alarm, maximum 1.2A for each circuit.

ALARM (COM, NC, NO) (XT11): Dry contact output energized in case of fire, rated 2.0A @ 30VDC.


FAULT (COM, NC, NO) (XT12): Dry contact output energized in case of fault, rated 2.0A @ 30VDC.

Supervisory (COM, NC, NO) (XT13): Dry contact output energized in case of abnormal conditions, rated 2.0A @ 30VDC.

Auxiliary 24VDC (XT10): Power limited output, maximum 0.75A.

Typical Connections

Signaling Line Circuits (SLC) loop connection is shown below.

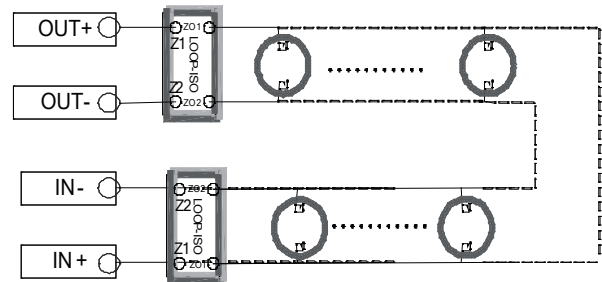

Cable Requirement

Loop: Minimum 17AWG, ideally 14AWG
Network: Minimum 17AWG, ideally 14AWG
Active Outputs: Minimum 16AWG, ideally 12AWG

All cables should be fire rated and follow local codes.

Certificates and Compliance

- Standards: UL864 / NFPA72
- Certifications: UL
- WEEE & RoHS Compliant

Technical Specification

Primary AC	120VAC/60Hz, 220VAC/50Hz
Power Consumption	Max. 2A
Backup Battery	20AH/24V
Loop Quantity	1 or 2
Device per loop	240 per loop
NAC output	2 Class B, 1.2A@24VDC each
Relay output	Fixed, Alarm/Fault/Supervisory
Auxiliary Power	Standby: 0.05A Max.: 0.75A
Display	128 X 64, LCD
Pc connection	RS232
Network connection	RS485 or CAN
Operating Environment	0-49°C / 32-120° F ≤93%, non-condensing
Color	Red
Dimension	406(W) X 666(H) X 130(D) mm ²

Order Information

Part No.	GST-M200
Device Name	Intelligent Fire Alarm Control Panel
Product No.	10103235

Accessories and Tools

I-9102(UL) Intelligent Photoelectric Smoke Detector
 I-9103(UL) Intelligent Rate of Rise and Fixed Temperature Heat Detector
 DZ-03(UL) Detector Base
 DI-M9101 Intelligent Combination Heat Photoelectric Smoke Detector
 DI-M9102 Intelligent Photoelectric Smoke Detector
 DI-M9103 Intelligent Rate of Rise and Fixed Temperature Heat Detector
 DB-M01 Detector base
 C-M9503 Loop Isolator
 DC-M9504 Base Mount Short Circuit Isolator
 I-M9300 Addressable Input Module
 I-M9301 Addressable Output Module
 DI-M9319 Digital Zone Monitor Module
 DI-M9305 Digital Single Riser Output Module
 DI-M9301 Digital Single Input and Output Module
 DI-M9300 Digital Single Input Module
 DC-M9503 Loop Isolator Module
 DI-M9204 Manual Call Point
 GSTGMC-M2.2 Graphic Monitor Center

Accessories and Tools



Part No.: LC200
 Device name: Loop Card
 Product No.: 20101370



Part No.: P-9930
 Device name: RS232
 Communication Card
 Product No.: 20101836



Part No.: P-M9930ModBus
 Device name: ModBus
 Communication Card
 Product No.: 20102531



Part No.: P-M9960A
 Device name: CAN Class A Network
 Card
 Product No.: 20102532